




# CUPERTINO SANITARY DISTRICT

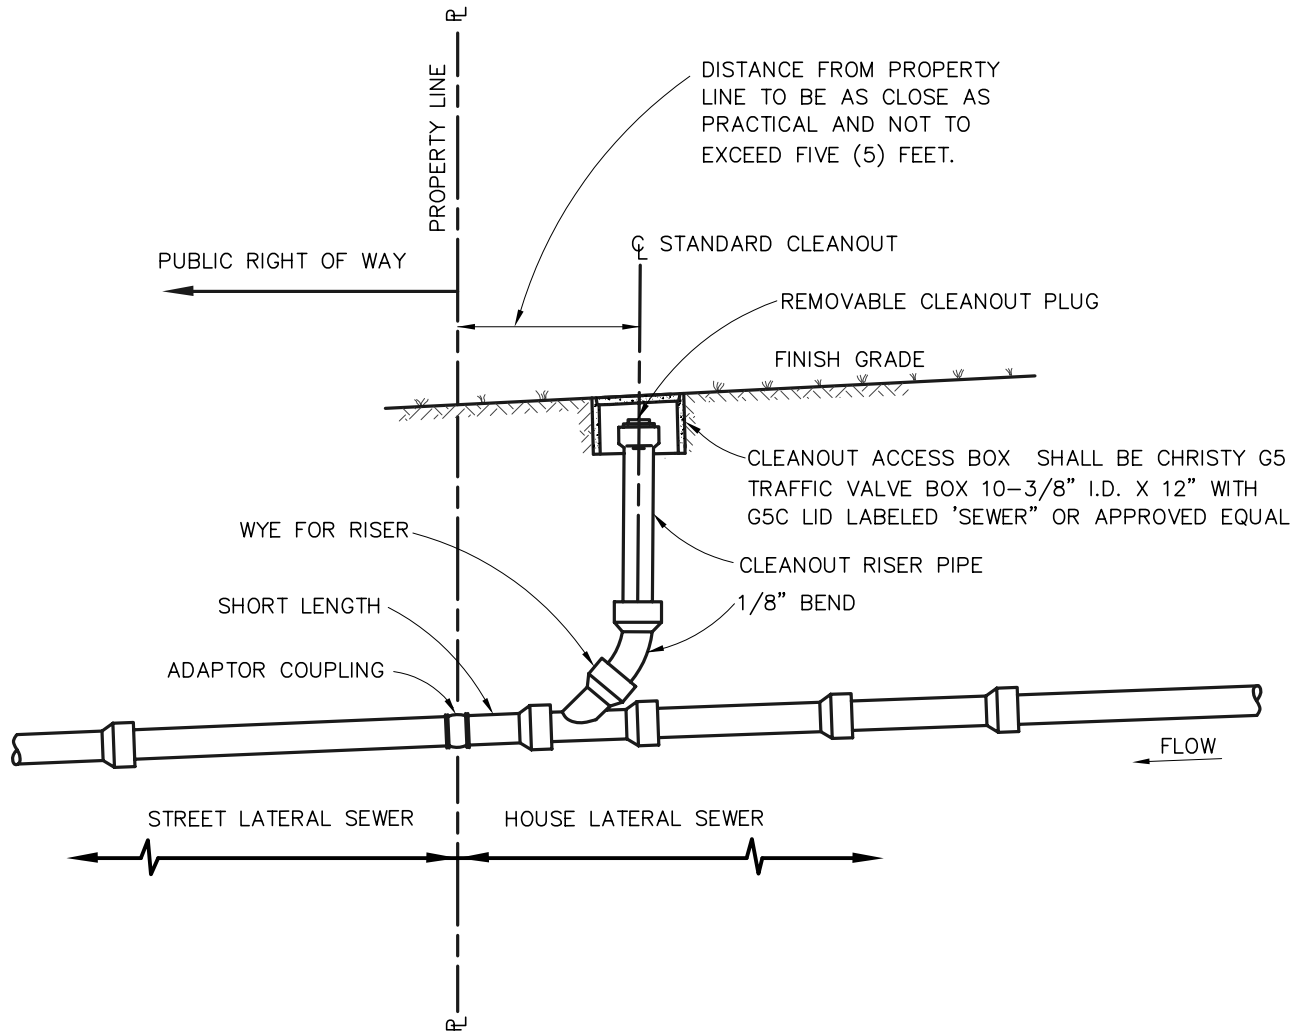

### NOTES:

1. MINIMUM PIPE SLOPE DETERMINED BY BUILDING DEPARTMENT.
2. LATERAL SEWER CLEANOUT TO BE SAME SIZE AS LATERAL SEWER.
3. AT LEAST 6-INCH CLEARANCE BETWEEN VALVE CAP AND INSIDE OF BOX REQUIRED.

FILE NO.  
SP-248

## STANDARD CLEANOUT

DETAIL J

DR. BY: HJP DATE: 05/13/03

CK. BY: DMT DATE: 05/14/03

APPROVED. BY:

*David E. Hall*

DATE: 5-15-03