




CUPERTINO SANITARY DISTRICT

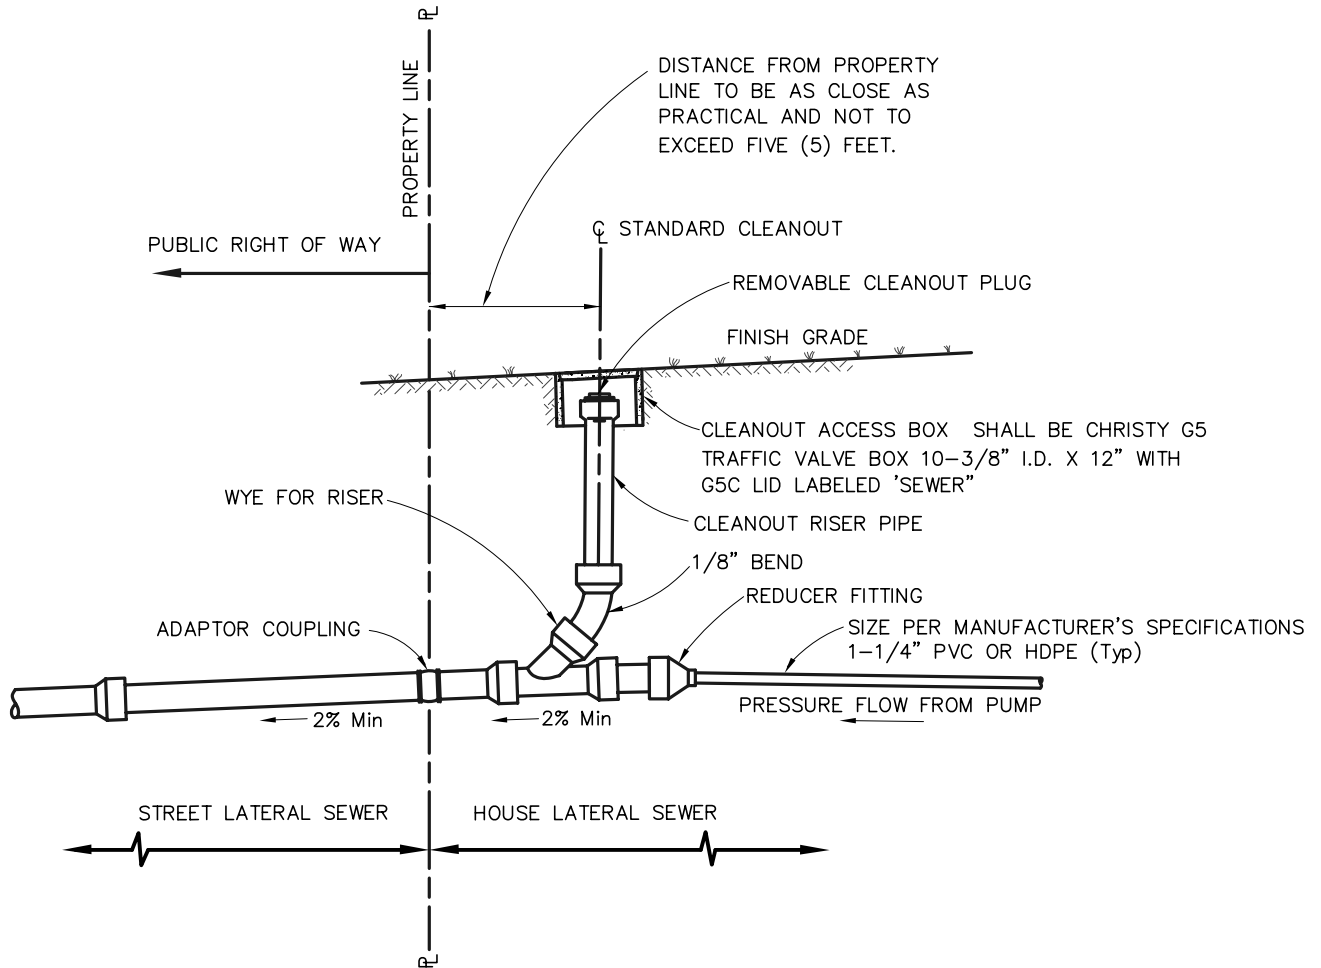

NOTES:

1. ALL ON-SITE PLUMBING, IN ACCORDANCE WITH LOCAL JURISDICTION BUILDING DEPARTMENT REQUIREMENTS.
2. LATERAL SEWER CLEANOUT TO BE SAME SIZE AS STREET LATERAL SEWER.
3. 6-INCH MINIMUM CLEARANCE BETWEEN REMOVABLE CLEANOUT PLUG AND INSIDE OF BOX REQUIRED.
4. REFER TO PUMP MANUFACTURER'S RECOMMENDATIONS FOR ANY ADDITIONAL EQUIPMENT REQUIRED FOR THE PRESSURE LINE AND CONNECTION TO GRAVITY SEWER.

FILE NO.
SP-248

STANDARD CLEANOUT W/ PUMP CONNECTION

DETAIL L

DR. BY: ACA DATE: 06/15/04

CK. BY: DMT DATE: 06/15/04

APPROVED. BY:

David E. Ross

DATE: 6-15-4